	
	YW-20190404-001
IM267	2019-04-04
	1 15

IM267

IM267

: 135 7383 0623

QQ:1774880258

RV2025

2755

<http://www.jnrovin.com>

DAVID

DAVID

IM267	20.4-28.8V DC	
	2A	
	500V	
5V DC	1500mA	
x x	71 x 80 x 62	

1.4

IP


1.5


IM267 IM267 GSDML IM 267 GSDML " PROFINET

IM267 GSDML "  IM267

PROFINET S7-200 I/O IM267 LAN

PROFINET

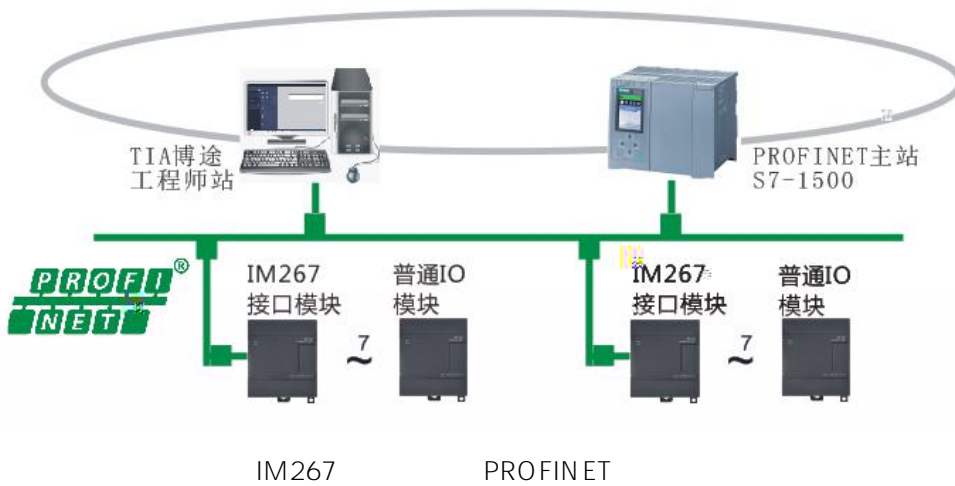

	
	YW-20190404-001
IM267	2019-04-04
	5 15

1.6 LED

IM267 LED

		—	
		—	
	0/	—	
	,	,	

2 TIA V15 IM267
IM267 S7-1215C PROFINET CPU
1200 IM267 I/O TIA Portal V15

2.1

IM267

S7-1200CPU

200 222-1PL22 + 222-1HH22 + 232-0HD22 + 231-7PC22

PROFINET

2.2

2.2.1

1 TIA Portal 1200

DAVID

W


W-20190404-001


H


IM267


DAVID

W

		
	YW-20190404-001	
IM267	2019-04-04	
	7	15

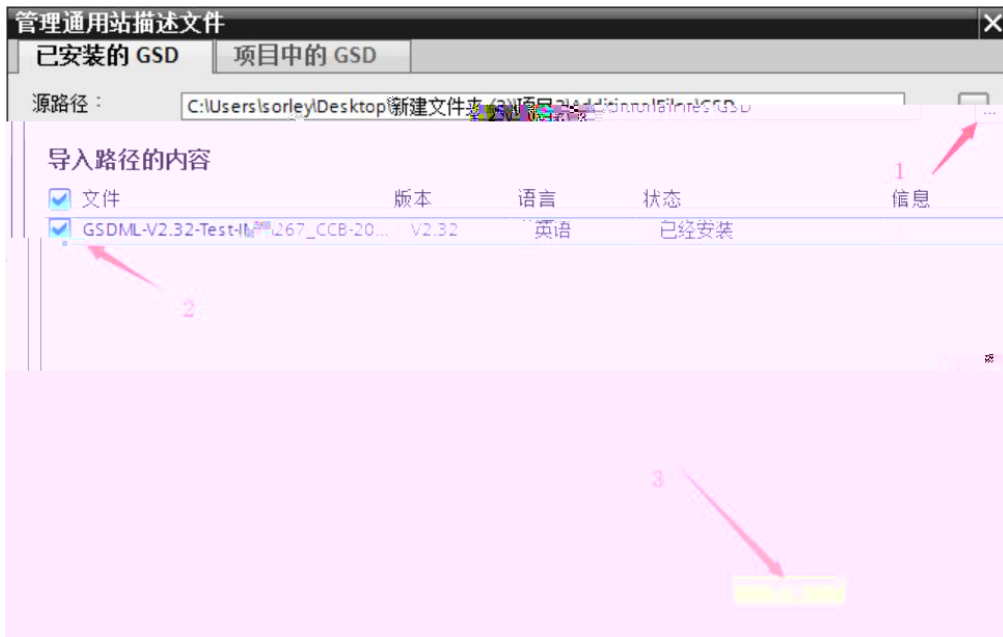

		
	YW-20190404-001	
IM267	2019-04-04	
	8	15

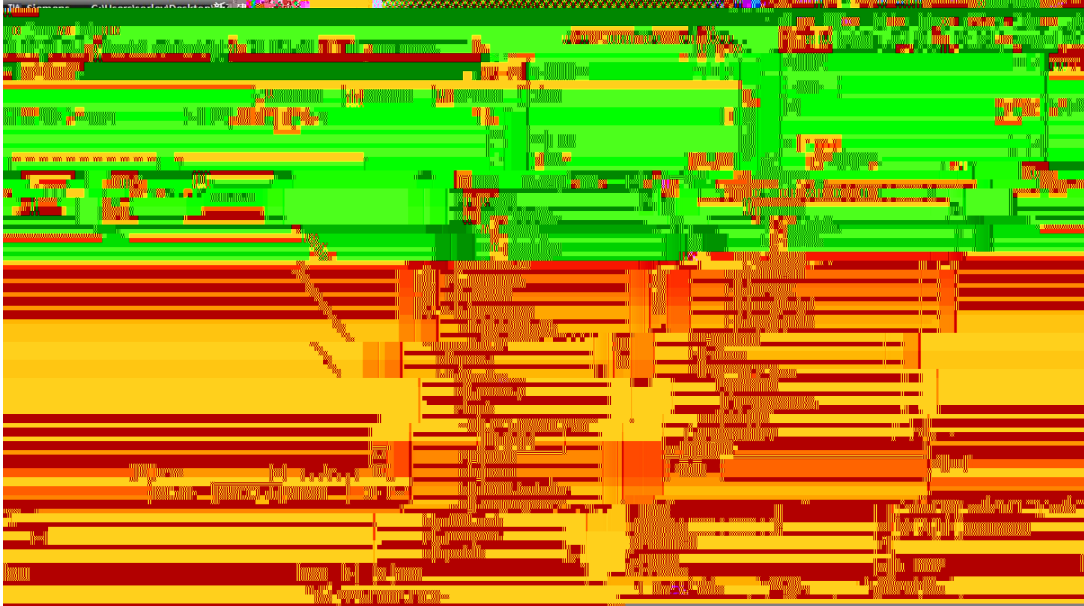


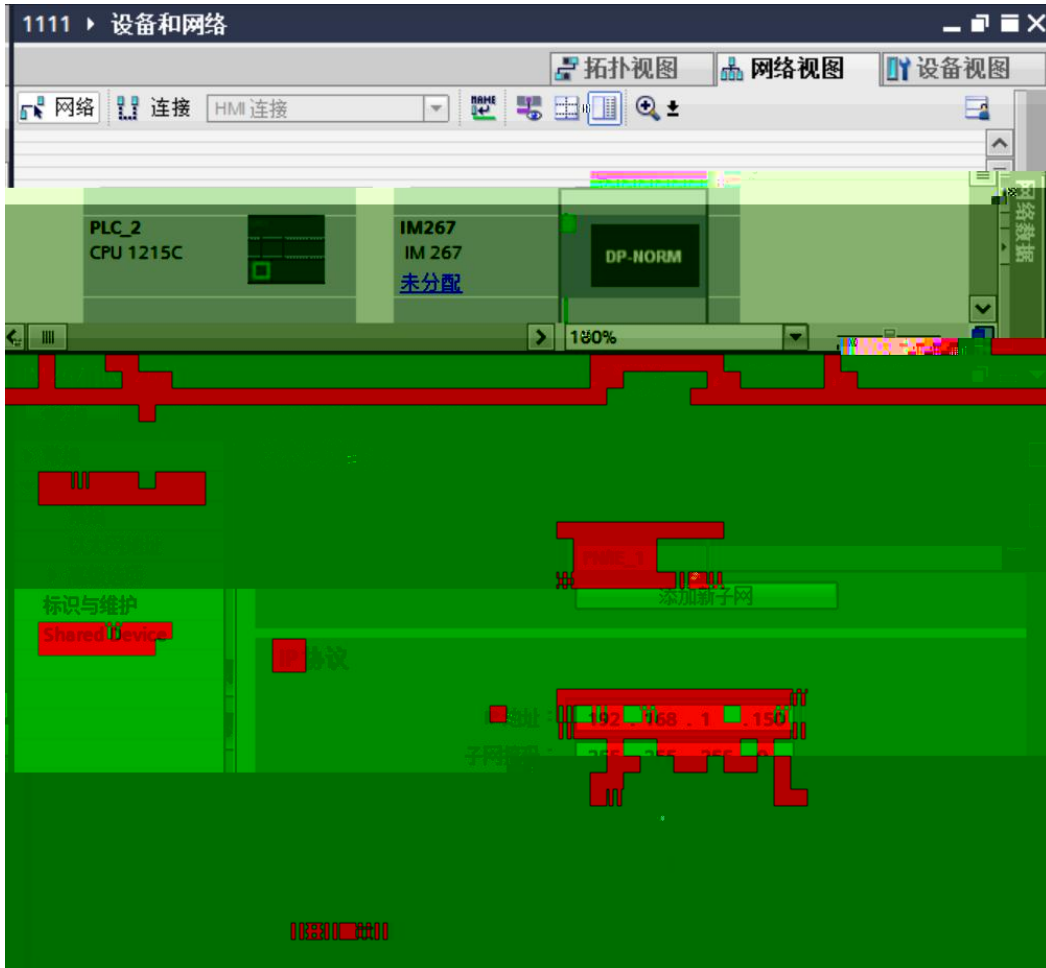
4

PLC IM267


PN/IE_1


IP

	
	YW-20190404-001
IM267	2019-04-04
	9 15



CPU ,

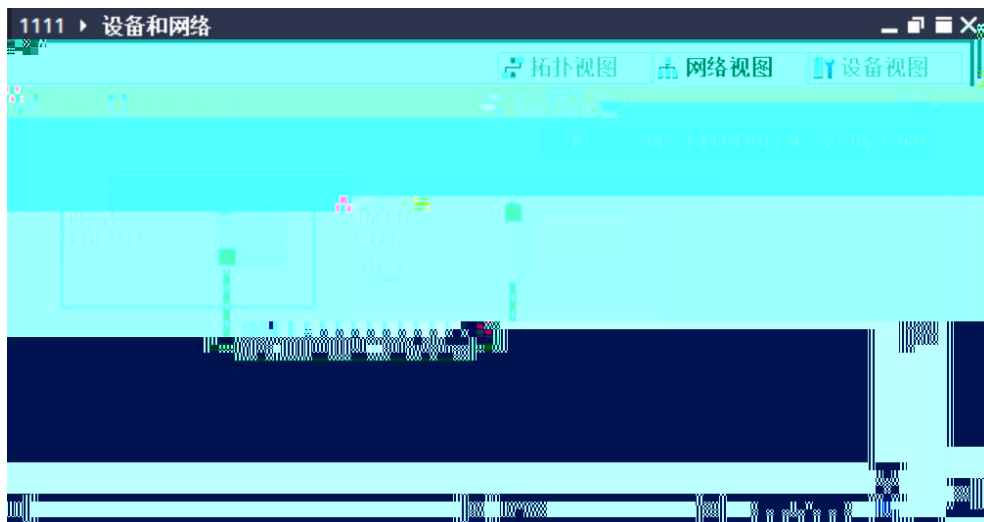

 IM267	YW-20190404-001	
	2019-04-04	
	10	15

5



6 IM267

IP

4


267


IP

IP

IM267- -


IM267

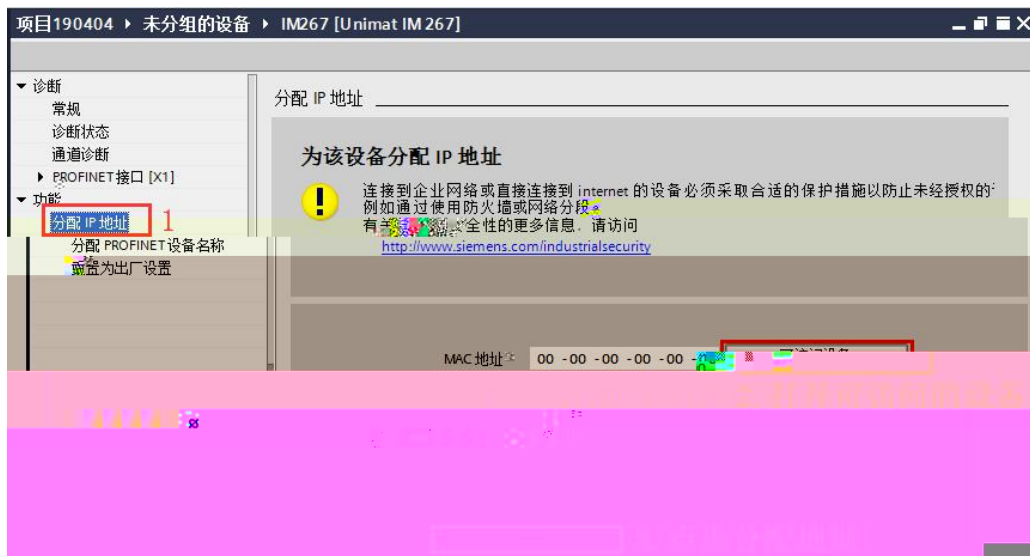

	
	YW-20190404-001
IM267	2019-04-04
	12 15

8

CPU

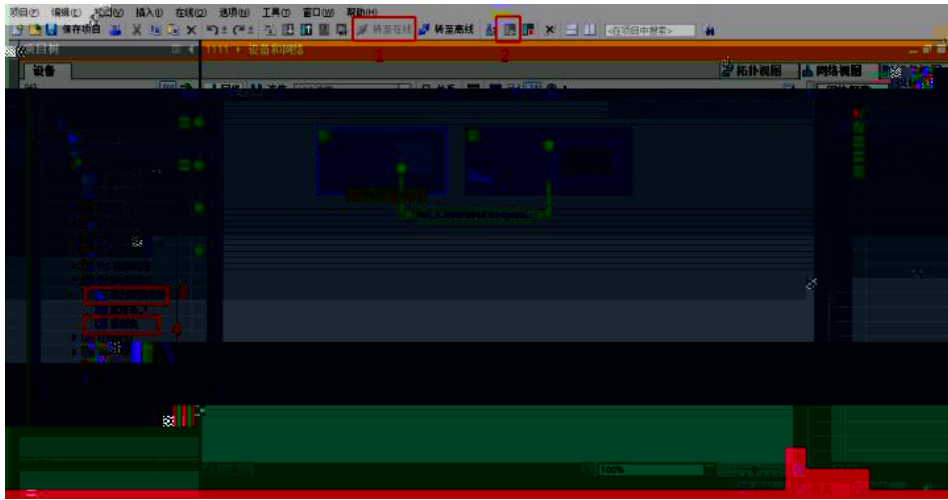

9

QW10,QW14 16000

5V,10mA

IW42

10

200PLC


B v D


IM267

20190404-001

9-04-04

B

 IM267	YW-20190404-001	
	2019-04-04	
	15	15

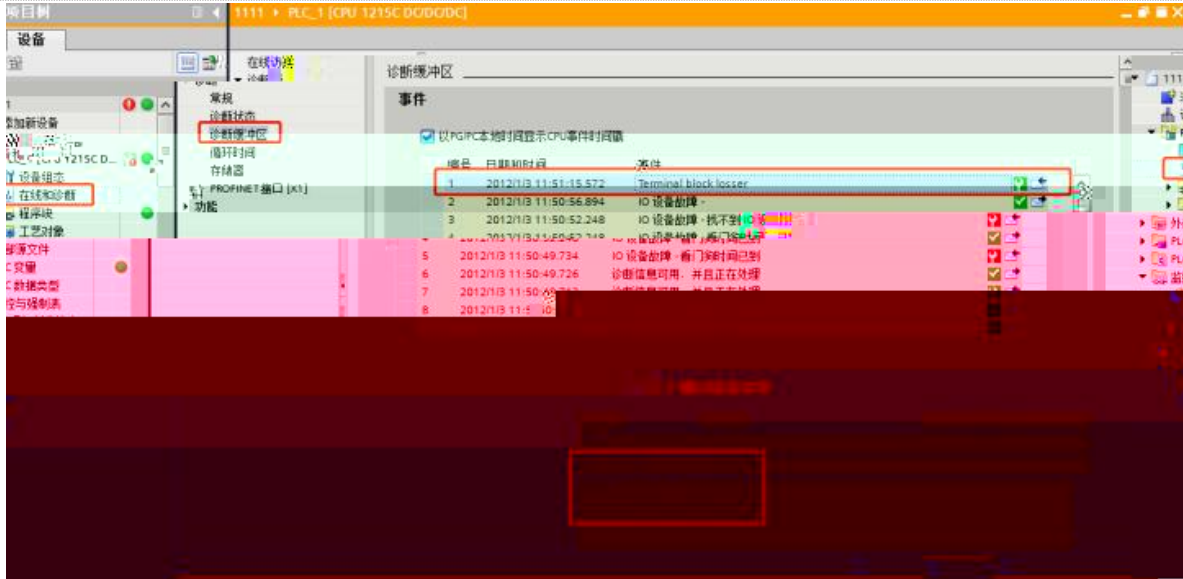

- Terminal block loss—
- Blown fuse Err—
- No user power Err—
- Out of-range Err—
- Bus Fault or parity err—
- Config Mask—

4

IM267

