





# RVNet-MB

Modbus

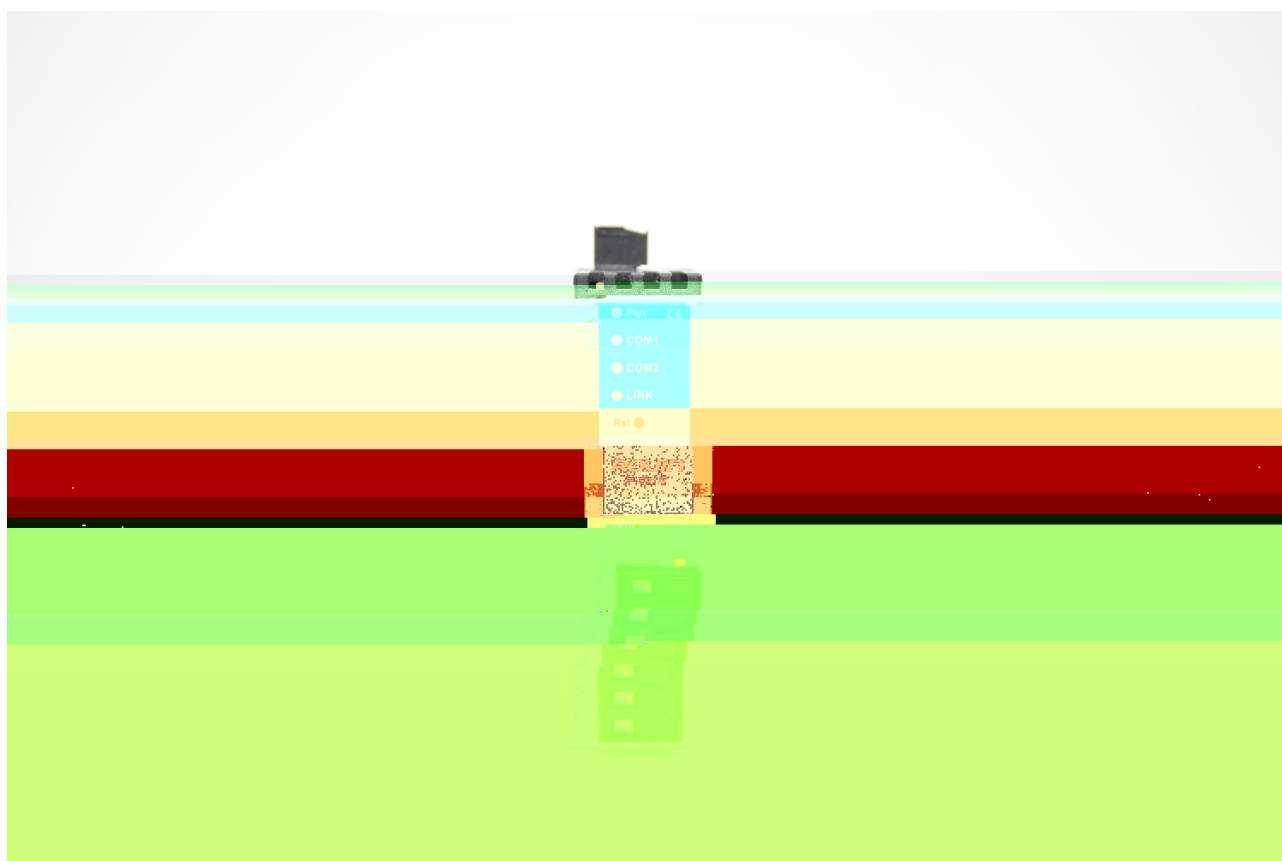

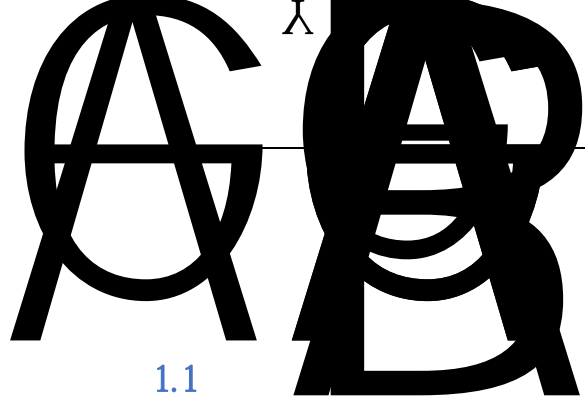

1.1

RVNet-MB



TCP

RVNet - MB  
 2 RVNet - MB Modbus RTU/ASCII Modbus TCP

PLC


TCP

RVNet - MB

TCP

3 RVNet - MB Modbus TCP 2 3ms


## 2.1

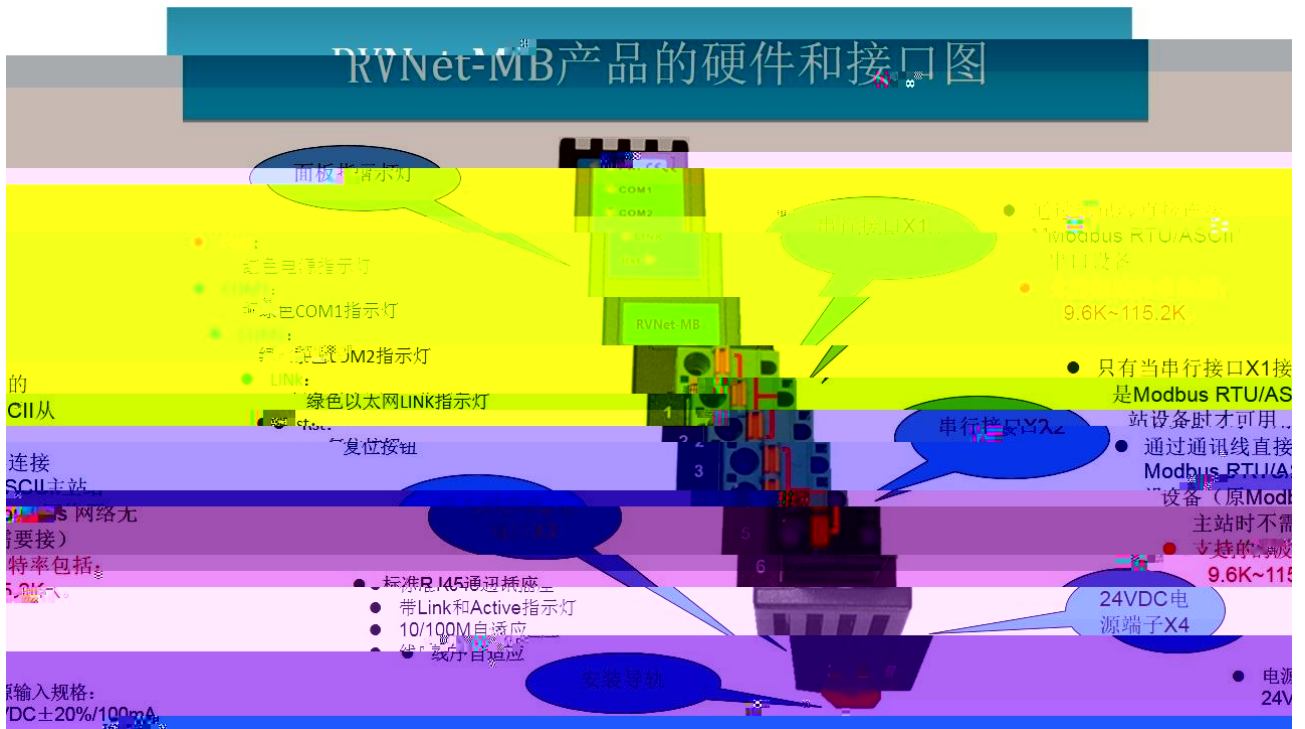

1.	X1	Modbus	RVNet - MB	Bus	- TCP	Modbus	X2
		Modbus	Modbus	Modbus	Modbus	Modbus	
		Modbus	RVNet - MB	Bus	-- TCP		
			X2				
2.	X2	X1	Modbus	RVNet - MB			Bus
					- TCP		
3. Rst:	5-6	COM					


2.2

2.2.1

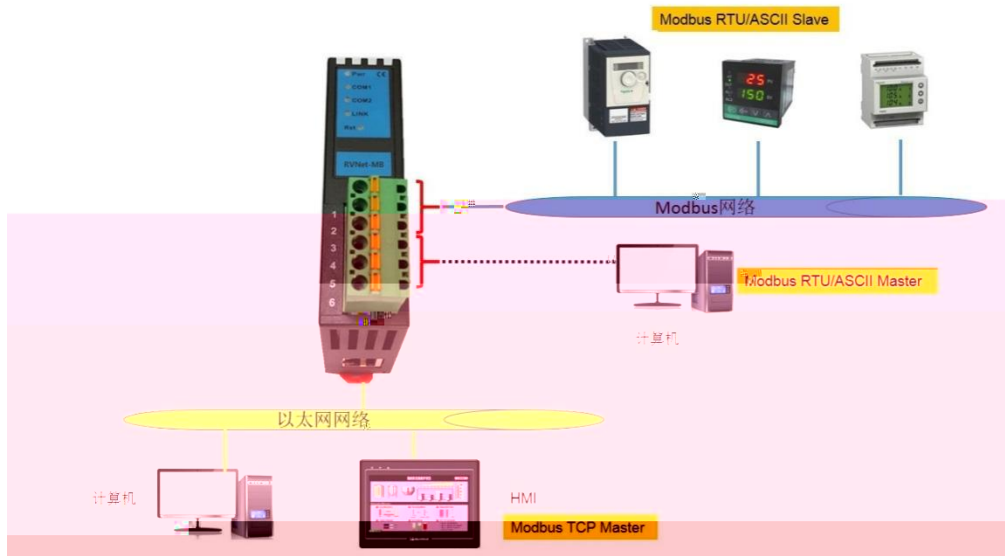

- |    |        |                  |              |
|----|--------|------------------|--------------|
| 1. | Modbus | Modbus           | X2           |
| 2. | 6      | Modbus RTU/ASCII |              |
| 3. | Modbus | RS485            | RS232 Modbus |
- Mosbus

2.2.2

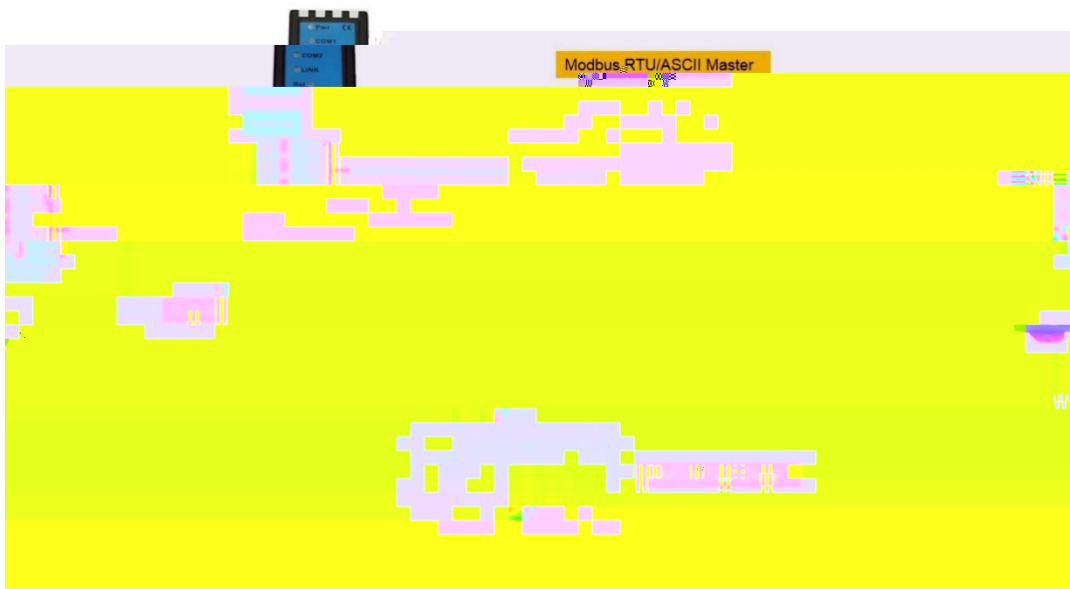

- |    |    |                  |            |
|----|----|------------------|------------|
| 1. |    | Modbus RTU/ASCII | Modbus TCP |
| 2. | X2 |                  |            |

**23**

RVNet-MB	4	X1	X2	RJ45	X3	X4
----------	---	----	----	------	----	----

RVNet-MB  
23 2 DC X4  
X4  
24VDC  
4VDC

RVNet-MB

24VDC±20% 100mA

24

RVNet-MB

LED




Pwr




Internet Explorer t

192.168.1.1 t r

3.2.1

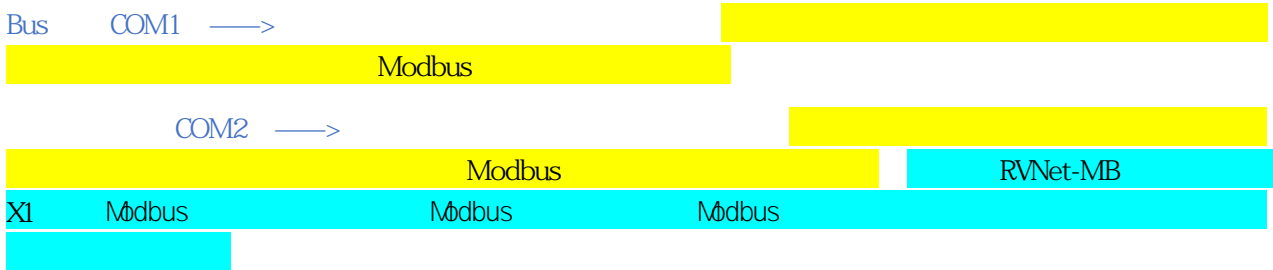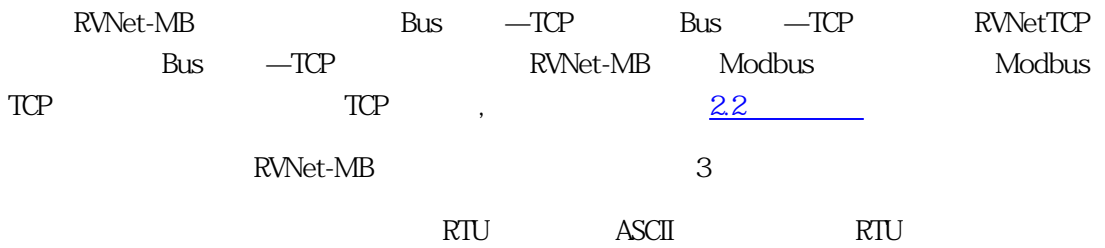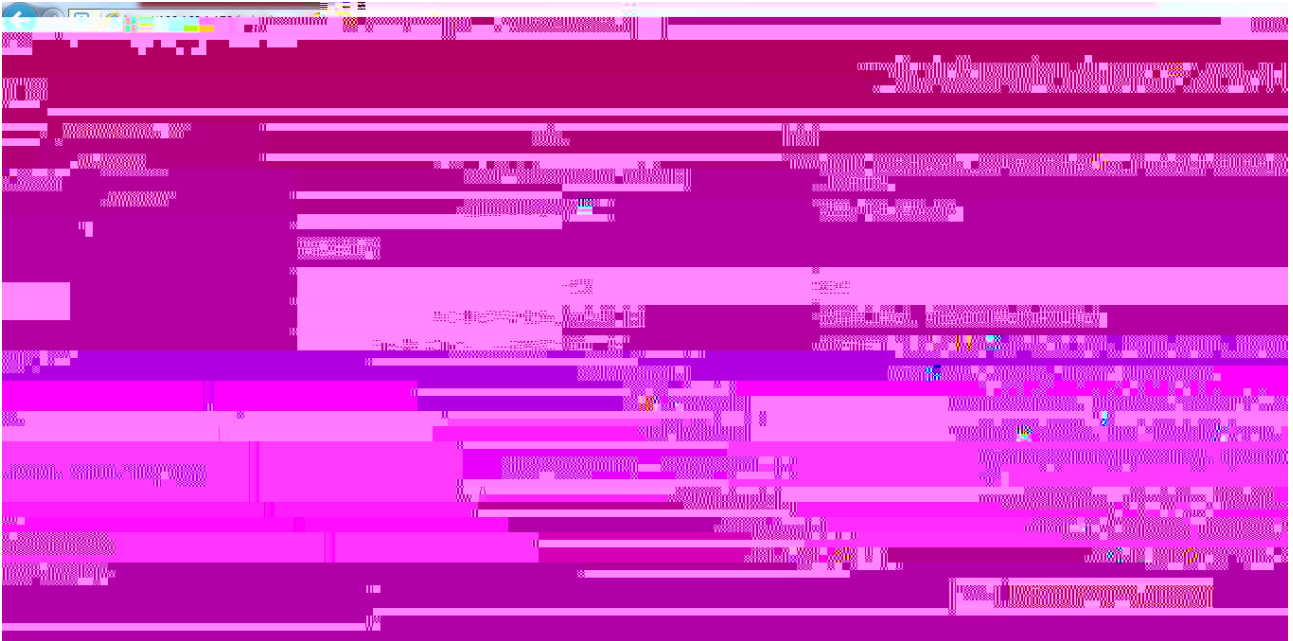

3.2.2

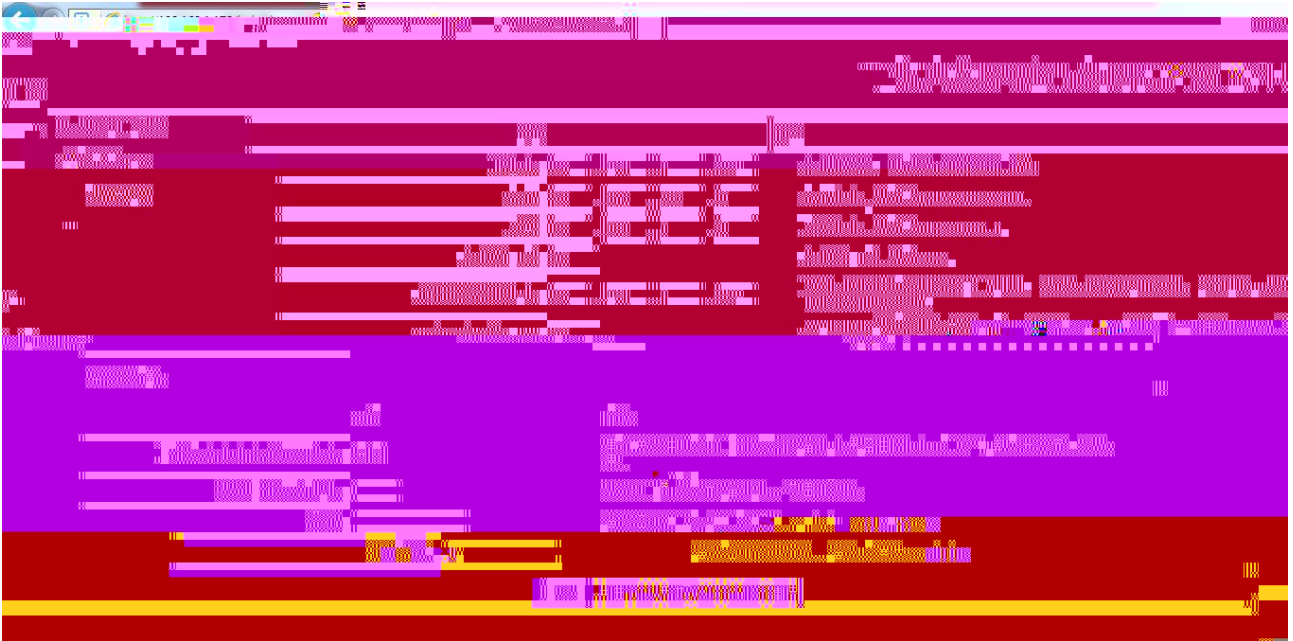

RVNet-MB IP

[ ]

RVNet-MB

IP

ModbusTCP

502

IP

RVNet-MB

IP

Bus

—TCP

RVNet-MB

Bus

—TCP

Modbus

“ ”

Bus

—TCP

“

”



modbus

Bus

—TCP


[ ]

RVNet-MB

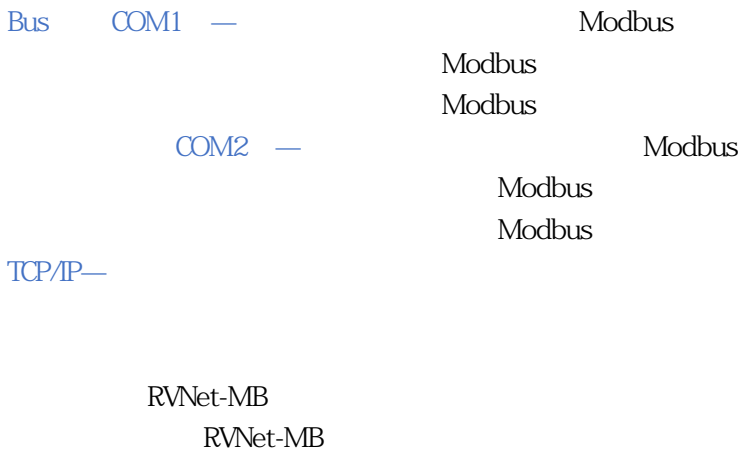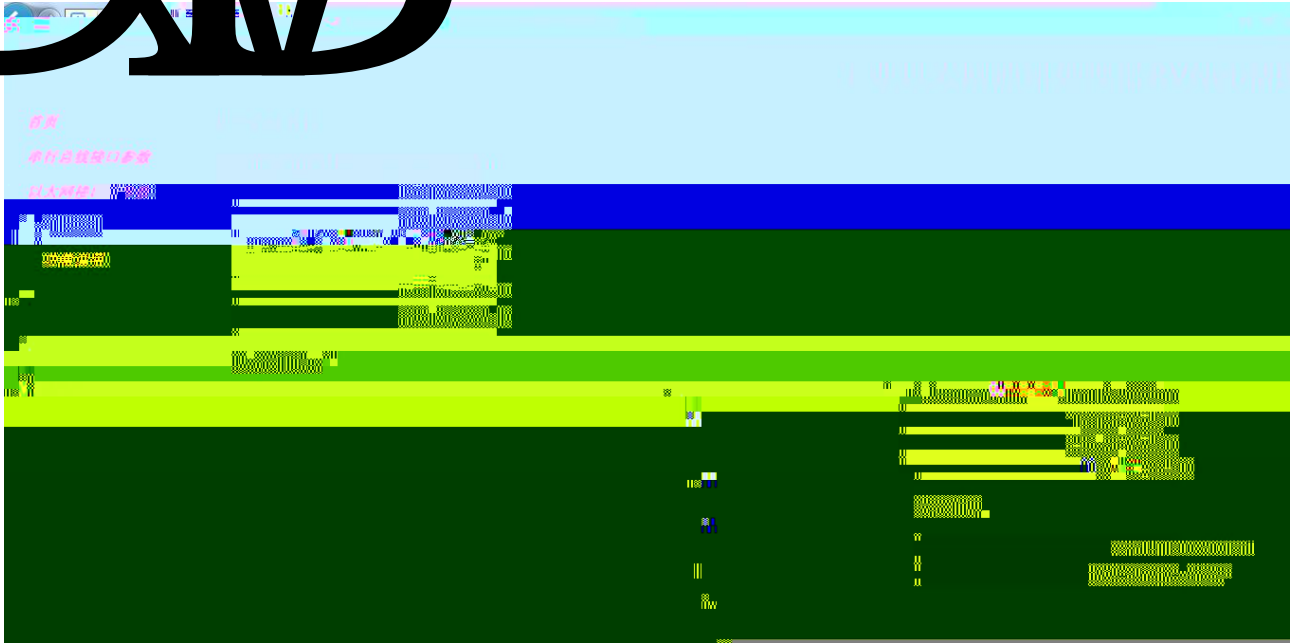


RVNet - MB                      SCADA                      ModbusTCP                      F tyDA-đ

## 4.1 RVNet-N

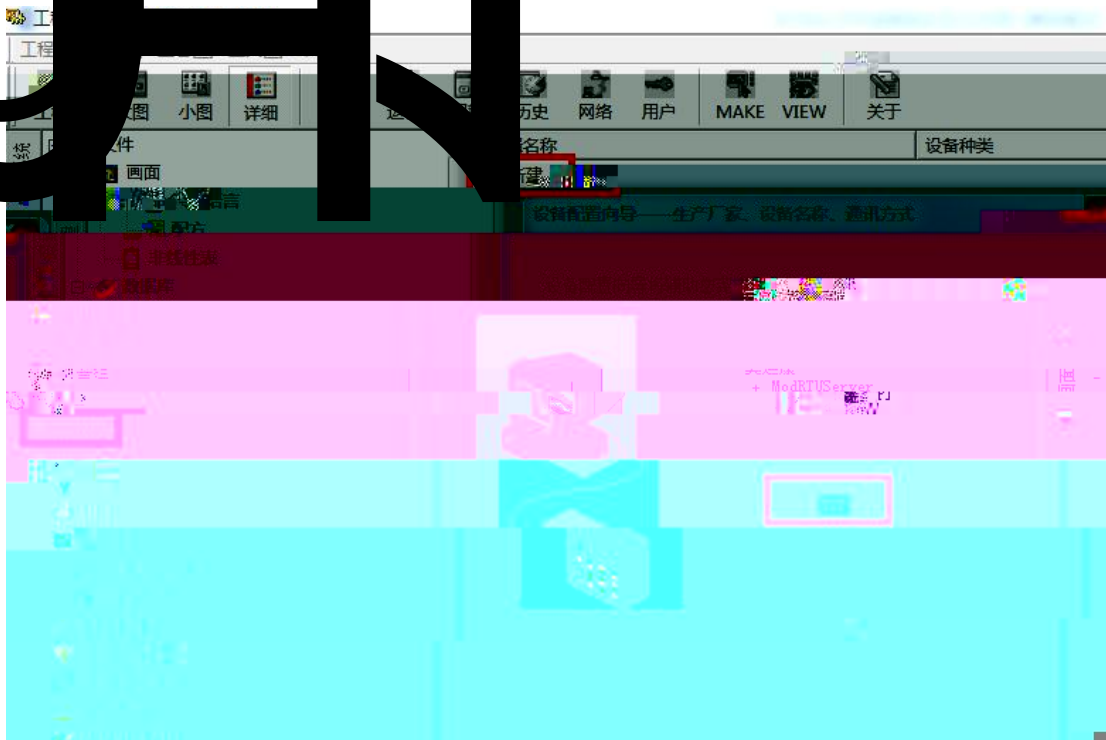

3.

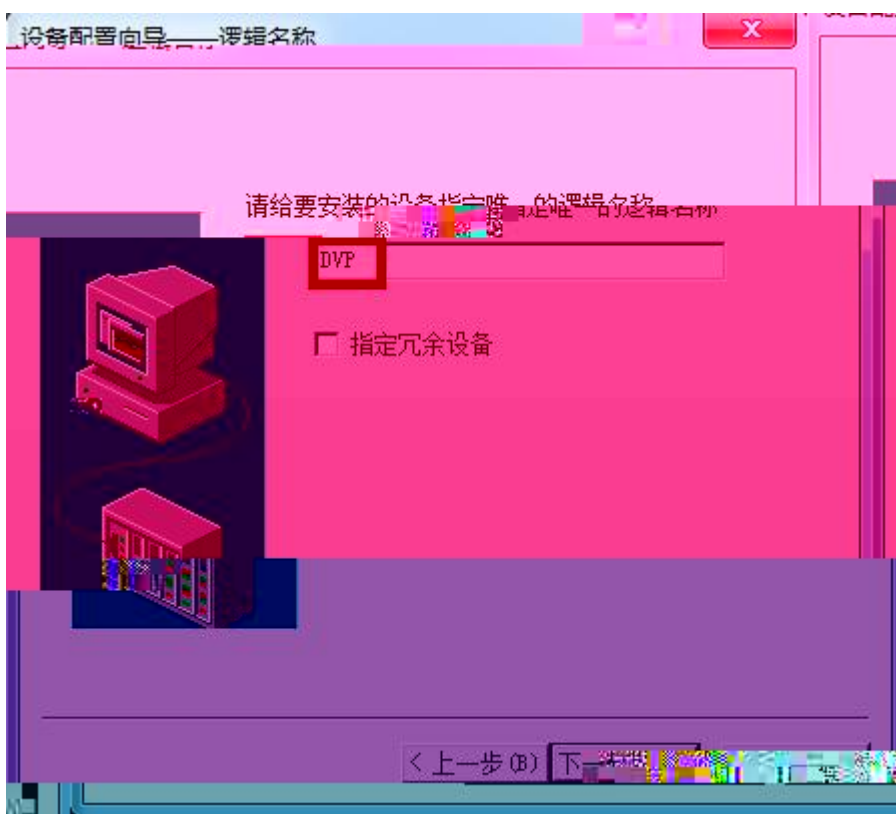


4. RVNet-MB-IP /



## 4.2 RVNet-MB


1. " IO " PLC " MODI CON -MODBUS TCP "

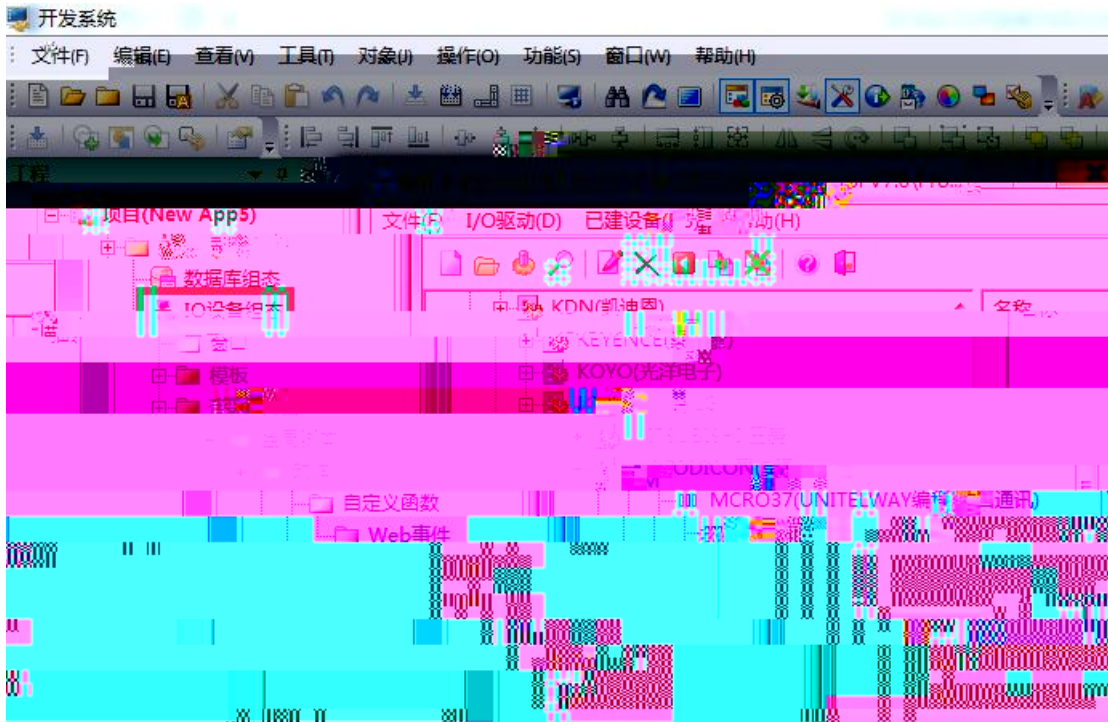

2. " " DVP " " 1 " " " Mdbus " "



3. " IP " RVNet-MB IP 192.168.1.178 " " 502

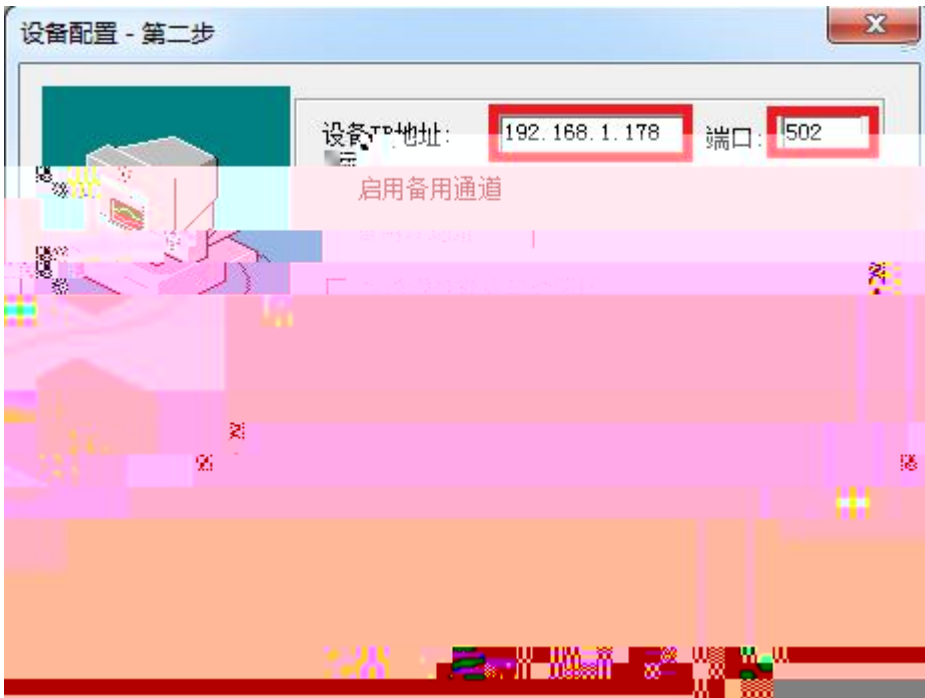

4.




### 4.3 RVNet-MB

1. " " " " " MB\_TCPI P " "




## 4.4 RVNet-MB      Kepware


1.      KEPServerEX      “ Click to add a channel ”      i

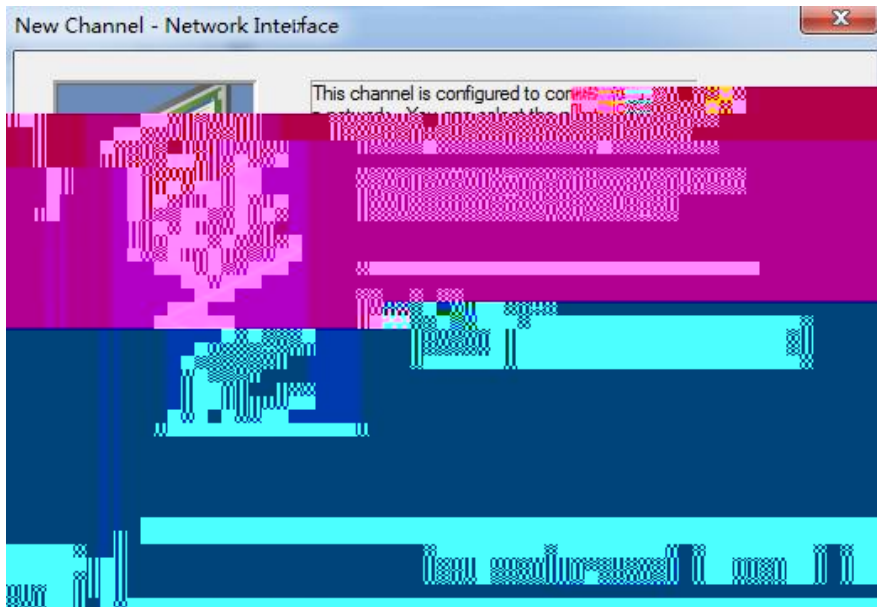


4. " click to add a device" ,

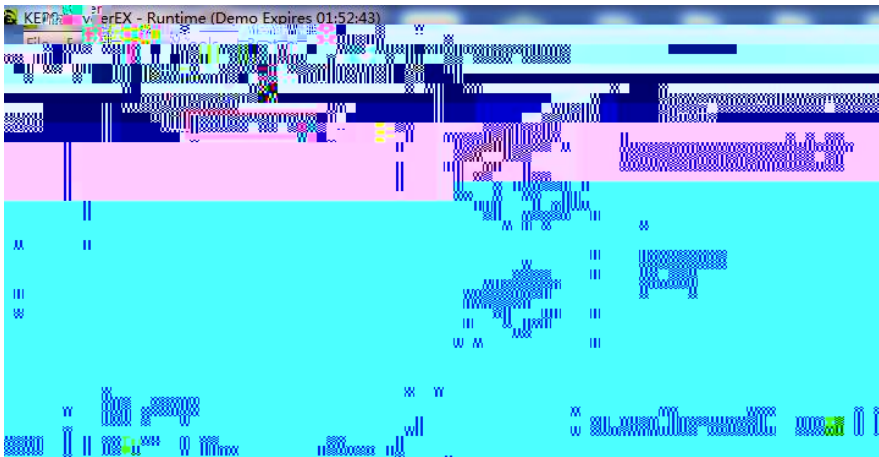


5. " Device Model " " Modbus"

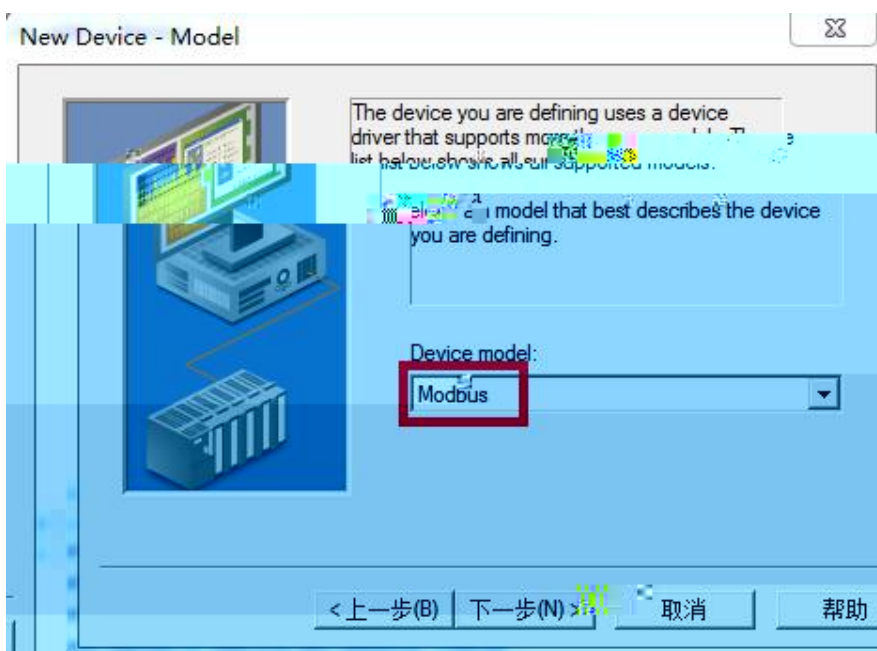

6. " Device ID" IP 192.168.1.178.0 Modbus

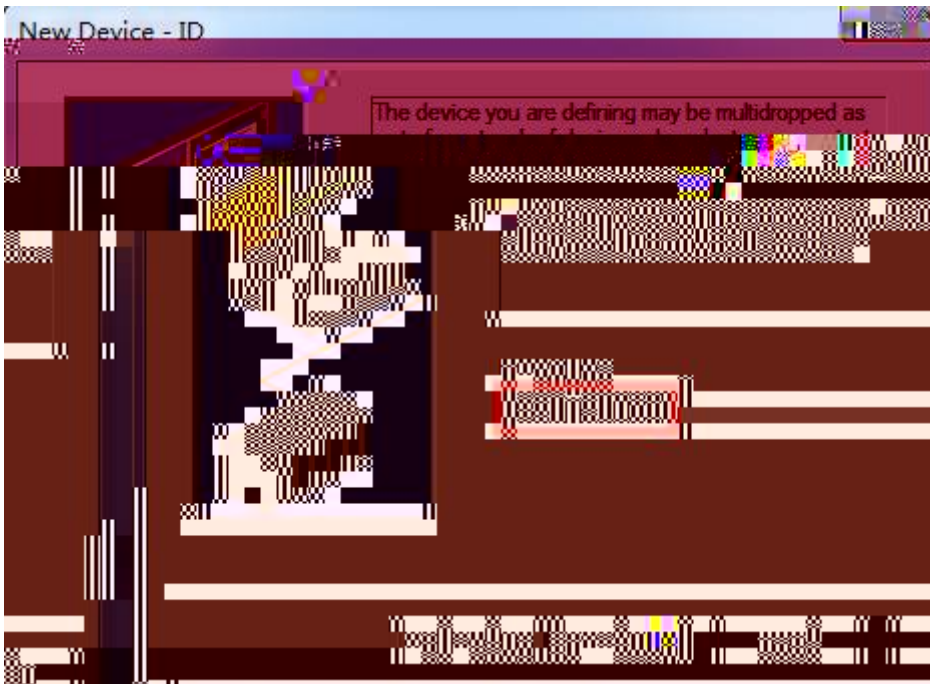


7.

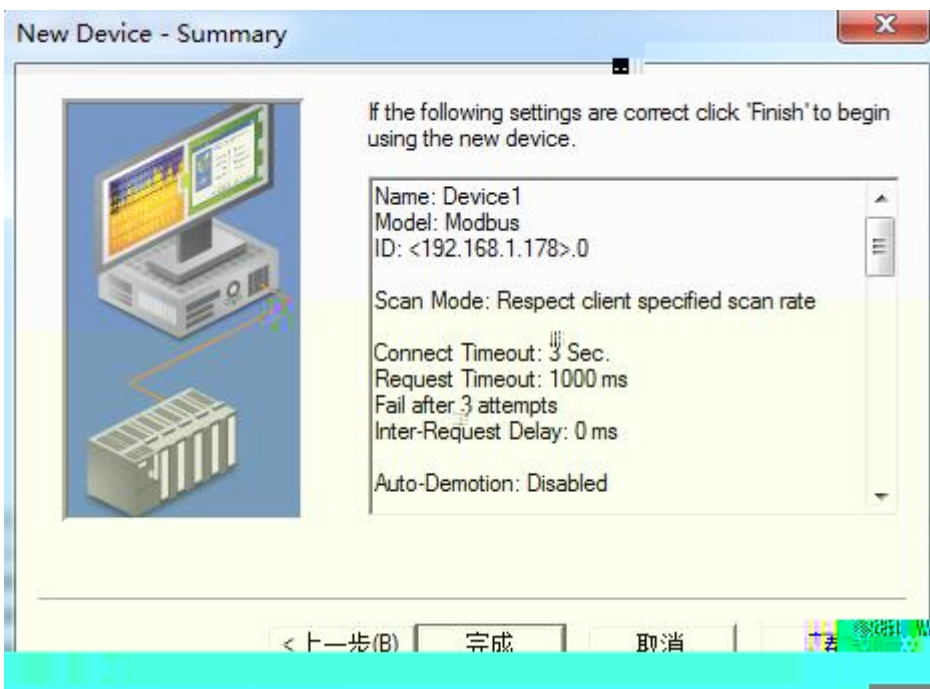

#### 4.5 RVNet-MB WINCC

1. Wincc " " " i

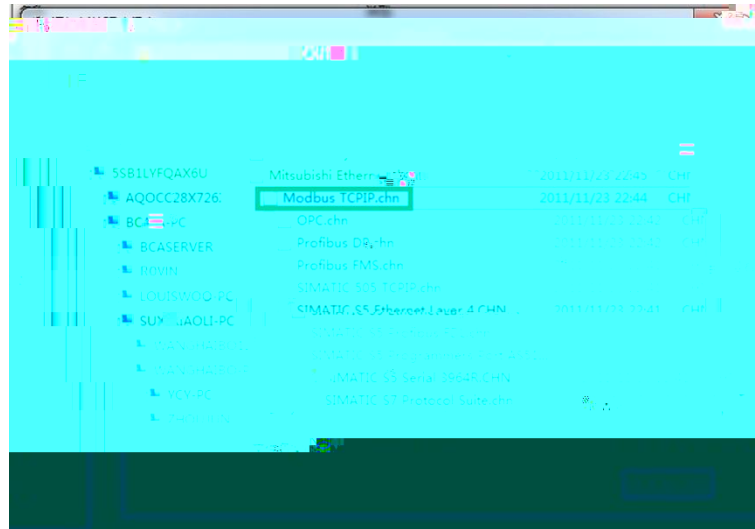

2. “Modbus TCP/IP #1” “ ” “ ” “ ”  
 “ CPU ” “ 984” “ ” RVNet-MB IP “ ” 502 ”  
 “ Modbus



Modbus

Pwr COM1 COM2 Link  
 IEEE 802.3 Link/Active Auto-MDIX  
 RJ45  
 10/100Mbps  
 Modbus TCP

TCP	6
X1	RS485 RS232
	9.6K~115.2Kbps
	Modbus RTU/M

2755

250101

0531-88689022

0531-88689022

111

266107

0532-68894021 83029299

0532-83029299

18753243991 [garywei@dingtalk.com](mailto:garywei@dingtalk.com)

[www.roviniot.com](http://www.roviniot.com)

